

for the proof of fire behaviour according to DIN 4102-1

Reference	FLT 3686619	(Translation of the German Prüfzeugnis - no guarantee for translation of technical terms)
Sponsor	Antalis International 8, rue de Seine F – 92100 Boulogne-Billancourt	
Test order	2017-01-31	Arrived 2017-02-07
Description of samples	Self-adhesive, colour-coated plastic film to be used on metallic substrates, named " Coala Vinyl W ". (for details see page 2)	
Delivered	2017-02-07	
Content of request	Proof of flammability to classify building materials to class B1 "schwerentflammbar" according to DIN 4102-1	
Assessment	The examined material compound meets the requirements of class B1 for "schwerentflammbare" (not easily flammable) building materials according to DIN 4102-1 if suspended freely or with distance if >40 mm to the same or other plain materials. (for details see page 5)	
Validity	2022-02-28	
Sampling	The samples have been sent to the laboratory by the manufacturer.	

Remark: If the above-mentioned building material is not used as product according to MBO § 2, there is no need for a general building supervisory test certificate.
This test certificate is not valid if the examined building material is used as product in the meaning of state building prescriptions (MBO § 17).

This test certificate does not replace an eventually necessary proof of applicability concerning building supervisory or building laws in the meaning of state building prescriptions. This has to be verified by:

- "allgemeine bauaufsichtliche Zulassung" (general building inspectorate approval) or by
- "allgemeines bauaufsichtliches Prüfzeugnis" (general building inspectorate certificate) or by
- "Zustimmung im Einzelfall" (exceptional approval).

This test certificate can serve as a basis for building supervisory procedures for:

- regulated building products for the pre scribed proof of conformity
- non-regulated building products for the needed proof of applicability.

This test certificate comprises 5 pages and 2 enclosures.

Approved testing, inspection and certification body

This test certificate must not be published and copied preceding agreement of the test laboratory and if agreed, only during validity and unchanged concerning appearance and contents. Agreement of the test laboratory has to be given in any case if norms in which the tests are based or other technical standards have changed.



Prüfstelle für das
Brandverhalten
von Baustoffen
Dipl.-Ing. Uwe Kühnast

Steinstrasse 18
D - 14822 Borkheide
Fon: +49 33845 90901
Fax: +49 33845 90909
Mail: info@firelabs.de
PÜZ-Stelle (LBO): BRA09

CERTIFICATE
TEST



1 Description of the test material

1.1 Description (according to the manufacturer)

The material provided is a film made of PVC with a one-sided colour coating and an adhesive application on the rear side. The adhesive was covered for protection with a siliconized paper. The self-adhesive film is intended to be used indoor, applied on metal surfaces and was named "Coala Vinyl W" by the sponsor.

1.2 Description of the delivered samples

For the tests the laboratory received a sample roll of a white plastic film with white coating and self-adhesive backing as well as a siliconized protective paper applied on the rear side. The sample roll had a length of about 20 m and a width of 1.07 m. The material was labelled with the trade name, article number and batch of the manufacturer and was named by the sponsor with the trade name "Coala Vinyl W".

Colour: white film, white coating, beige paper liner

Characteristic values: table 1; photos: see enclosures.

Further information are not known to the laboratory, information on the manufacturer and a retain sample are deposited.

2 Preparation of samples

For the small burner test ("Brennkastenprüfung") samples for edge flame exposure (dimensions 190 mm x 90 mm) and samples for surface flame exposure (dimensions 230 mm x 90 mm) have been cut and applied on uncoated aluminium sheets (thickness 1,0 mm)..

For the fire shaft test ("Brandschacht") 2 specimen were prepared. The samples (dimensions 1000 mm x 190 mm) of test specimen A were cut in longitudinal, the samples for the test specimen B in transverse orientation of the material and applied on uncoated aluminium sheets (thickness 1,0 mm).

Afterwards all samples kept in a climate chamber acc. DIN 50014-23/50-2 until they reached constant weight.

3 Test procedure

The tests in the fire shaft ("Brandschacht") have been performed acc. DIN 4102-1 and -16 (building materials class B1). The small burner tests ("Brennkastenprüfungen") have been performed acc. DIN 4102-1, chapter 6.2.5 (building materials class B2). No additional substrate was arranged behind the material compound.

Examination period: March 2017

4 Results

- section 4.1 Material characteristics
- section 4.2.1 Test results class B2 (Brennkasten)
- section 4.2.2 Test results class B1 (Brandschacht)

4.1 Material characteristics

Table 1

Characteristics			Manufacturer's data	Measured values (m.v.)
Film with coating and adhesive layer	Thickness	[mm]	0,13	0,15 (s=0,002)
	Weight per area unit	[g/m ²]	./.	170
Protective paper	Thickness	[mm]	./.	0,14
	Weight per area unit	[g/m ²]	./.	137
Coated, self-adhesive film with protective paper	Thickness	[mm]	0,3	0,29
	Weight per area unit	[g/m ²]	280	307

m.v. mean value

s standard deviation

./. not received/not measured



Test results "Brandschachtprüfung" (part 2)						
line no.		Test results				requirements
		A	B	C	D	
17	<u>Afterflame after end of test</u>	No	No	-	-	
18	Time min:s					
19	Number of specimen					
20	Front side of specimen					
21	Back side of specimen					
21	Flame length cm					
22	<u>Afterglow after end of test</u>	No	No	-	-	
23	Time min:s					
24	Number of specimen					
25	<u>Place of appearance:</u>					
26	Lower half of specimen					
27	Upper half of specimen					
28	Front side of specimen					
29	Back side of specimen					
28	<u>Smoke density</u>					
29	≤ 400 % min	23,1	25,6	-	-	
30	≥ 400 % min (very strong smoke density)	./.	./.	-	-	
30	Diagram fig. no.	1	3	-	-	
31	<u>Residual length</u>					
	Individual value cm	46	47	-	-	> 0
		45	44	-	-	
		47	48	-	-	
		49	46	-	-	
32	Average value cm	46	46	-	-	≥ 15
33	Photo of the test specimen fig. no.	2	4	-	-	
34	<u>Flue gas temperature</u>					
35	Maximum of average value ...°C	115	110	-	-	≤ 200
36	Time ¹⁾ min:s	9:58	10:00	-	-	
36	Diagram fig. no.	1	3	-	-	
37	<u>Remarks:</u> line 13: Afterflame time at the bottom of the sieve < 20 sec. is not rated as "falling of burning parts or droplets" line 32: Due to the residual length of ≥ 45 cm further tests are not performed (DIN 4102-16: 2015-09, 5.2 b)).					

¹⁾ indication of time: from the beginning of testing procedure

- not tested

./. not occurred

*) no cause for complaint

Specimen	Test-No.	Type name	Orientation of samples	Substrate
A	615217-001	"Coala Vinyl W"	longitudinal	aluminium sheet
B	615217-002		transversal	



5 Assessment

Section 4.2 lists the test results of the composite which is described in section 1 and compares the results with the requirements for not easily flammable building materials acc. DIN 4102-1. According to the test results the coated self-adhesive plastic foil, fulfils the requirements of building materials class B1 according to DIN 4102-1, if used on one side onto metal surfaces:

- with a density $\geq 2025 \text{ kg/m}^3$, a melting point $\geq 500 \text{ °C}$ and a thickness $\geq 0,8 \text{ mm}$
 - with a density $\geq 5890 \text{ kg/m}^3$, a melting point $\geq 1000 \text{ °C}$ and a thickness $\geq 0,6 \text{ mm}$
- and if the composite is mounted in a distance of $> 40 \text{ mm}$ to the same or other plain materials.

The requirements of building materials class B2 are also fulfilled, no falling of burning parts or droplets occurred during these tests.

The verification for outdoor usage (ageing behaviour by outdoor weathering) has not been proved.

6 Special remarks

This certificate is only valid for the material as described under paragraph 1. In combination with other materials or with additional coatings or surfaces etc. the burning behaviour may differ.

This test certificate is not valid, as soon as the product is used as a building product in the sense of the "Landesbauordnungen" (state building requirements, MBO § 17).

This test certificate is no substitute for a General Building Inspectorate Certificate. This test certificate is granted without prejudice to the rights of third parties, or particular private proprietary rights.

In General Building Inspectorates procedures this test certificate can be based for

- regulated building materials for the required proof of accordance
- for not regulated building materials for the required proof of applicability

The explanations given in DIN 4102-1 app. D, especially concerning an external production control has to be considered.

This test certificate is valid until 2022-02-28, provided that the test methods, the classification rules and the technology do not change during this period.

Borkheide, 9th of April 2019



Head of the test laboratory
(Dipl.-Ing. Uwe Kühnast)



This translation was issued the 9th of April 2019, in a case of doubt the German version is valid solely.

Test specimen A

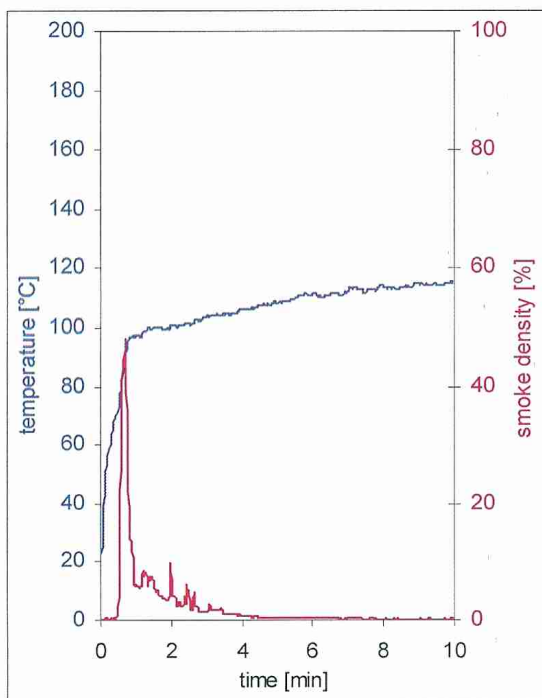


fig. 1
Graphs of the flue gas temperature and the smoke density

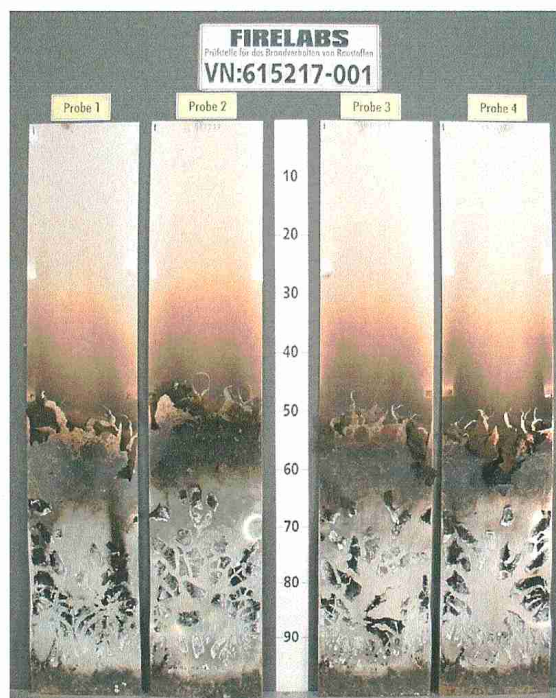


fig. 2
Photo of the test specimen after the test

Test specimen B

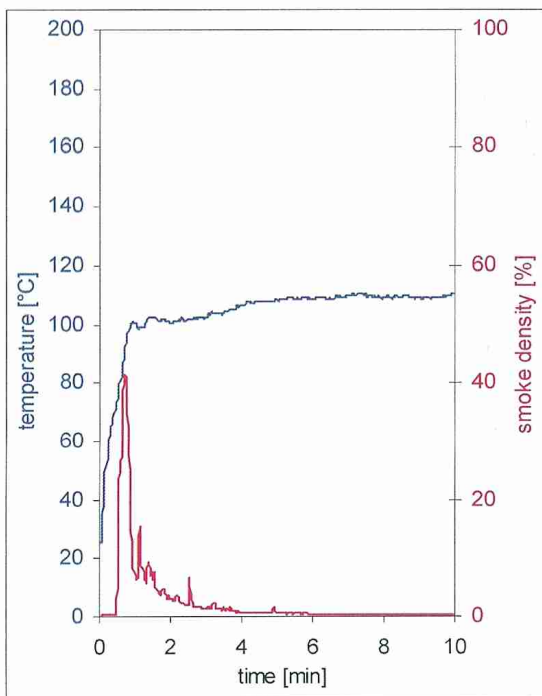


fig. 3
Graphs of the flue gas temperature and the smoke density

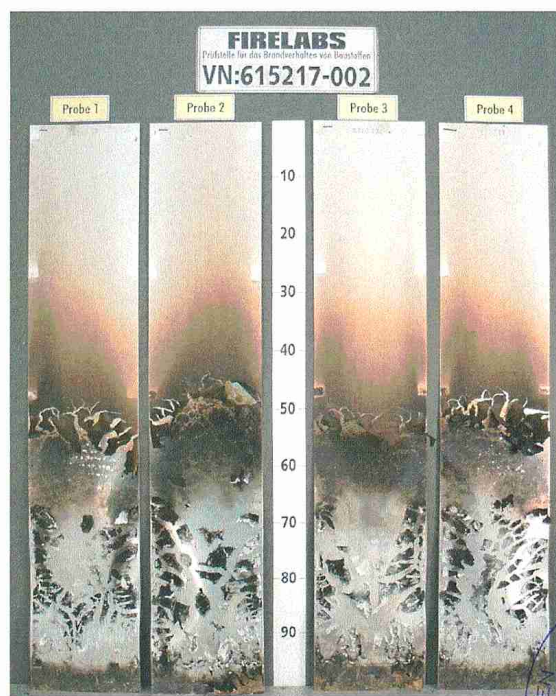


fig. 4
Photo of the test specimen after the test



Test results small burner test (Brennkasten)

Table 2

	longitudinal						transversal						dim.	requirements
Sample-No.	1	2	3	4	5	6	1	2	3	4	5	6	-	-
Ignition of the sample	7	5	4	6	3	./.	5	8	5	4	4	./.	s	-
Maximum flame height	1	1	1	1	1	1	1	1	1	1	1	1	cm	-
Time of the maximum	15	15	15	15	15	15	15	15	15	15	15	15	s	-
Flame tip reached the 150 mm test mark	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	s	≥ 20
Self-extinguishing of flames	16	16	16	16	16	16	16	16	16	16	16	16	s	-
Ignition of filter paper	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	s	¹⁾
Smoke density	very low						very low						-	-
Afterburning after end of test	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	./.	s	-

View of the samples after the test (20 seconds after exposure the flame):

- damaged area at the point of flame impingement: approx. 10 mm height x 10 mm width

Samples 1-5: edge exposure

Samples 6: surface exposure

¹⁾ No ignition within 20 seconds

./.. Not occurred

dim. Dimension

Indication of time: from the beginning of testing procedure

Indication of measurements: from reference line of the flame

